


SPECIFICATIONS:

- a. There must be a raceway provided by the contractor/owner.
- b. Schedule 40 PVC conduit, not to exceed 300 feet, is to be used.
- c. Conduit at residential locations must be two inches or greater.
- d. Conduit at business locations must be two inches or greater.
- e. Conduit may contain no more than three 24' sweep L's (90 degrees).
- f. Each conduit must have a high quality nylon pull string placed in it.
- g. Buried conduit must be two feet below finished ground level.
- h. Conduit termination must be located within three to five feet of the power service entrance for grounding purposes and three to five feet above ground level.
- i. Buried conduit must be flush with electric pole.

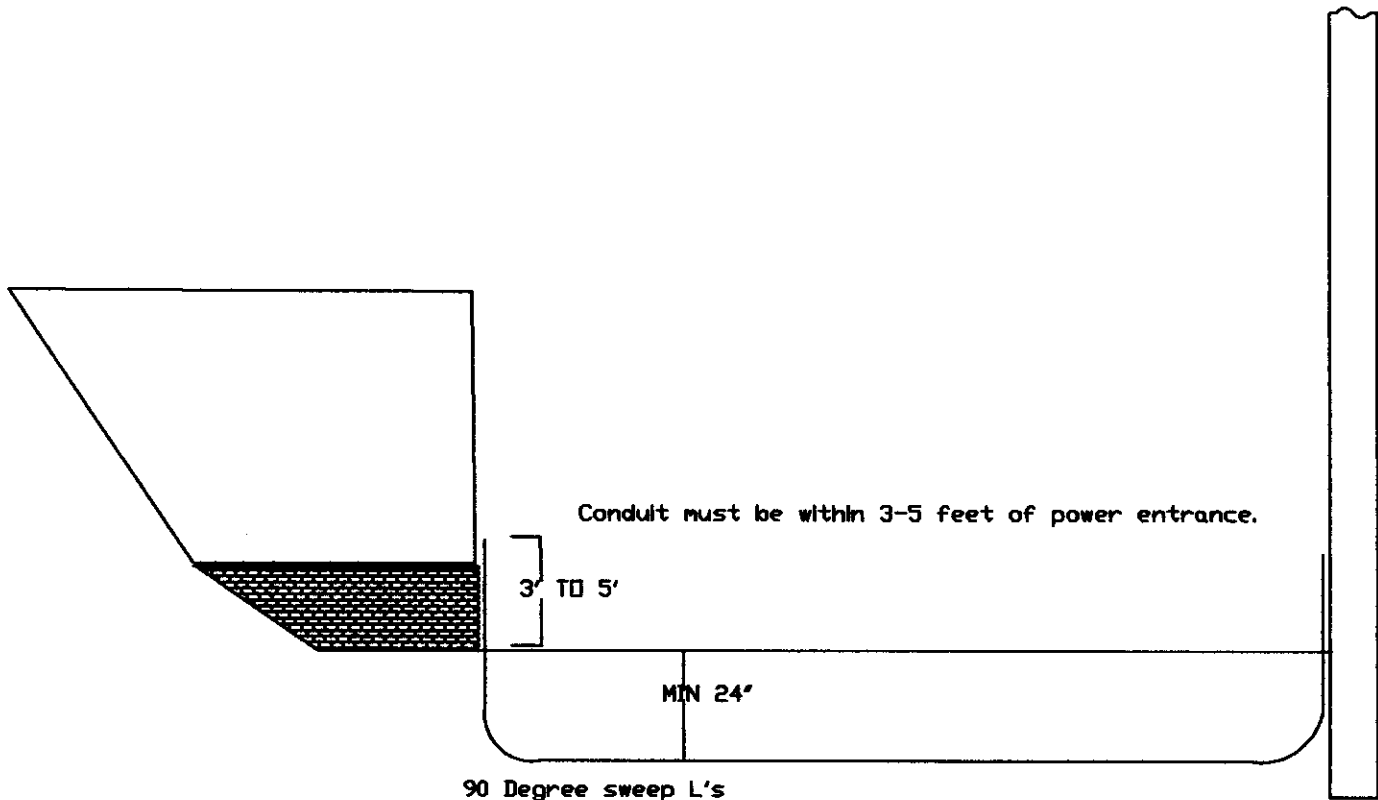

Residential >2" schedule 40 PVC with a high quality pull string
Business >2" schedule 40 PVC with a high quality pull string