

611


Dial Before You Dig

You May Be
Digging Into
Underground
Telephone Cable
Or Conduit



Buried Service Specifications

1. To protect your buried services, it is highly recommended that a raceway be provided by a contractor/property owner.
 - A. Schedule 40 PVC conduit, not to exceed 300 ft., is to be used. If greater than 300 ft., contact DTC Engineering Department to determine if additional requirements are needed.
 - B. Conduit at residential locations must be two inches outside diameter or greater.
 - C. Conduit at business locations must be two inches outside diameter or greater.
 - D. Conduit may contain no more than three 24" sweep L's (90 degrees).
 - E. Each conduit must have a high quality nylon pull rope.
 - F. Buried conduit must be two feet below finished ground level.
 - G. Conduit termination must be located within three to five feet of the power service entrance for grounding purposes and three to five feet above ground level.

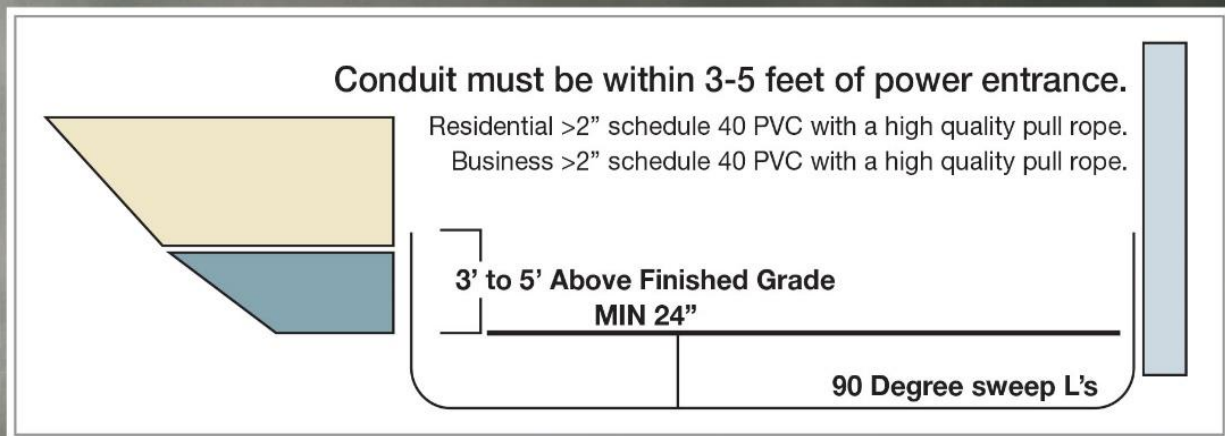

All Exchanges
(from your home or business phone)

Dial 611